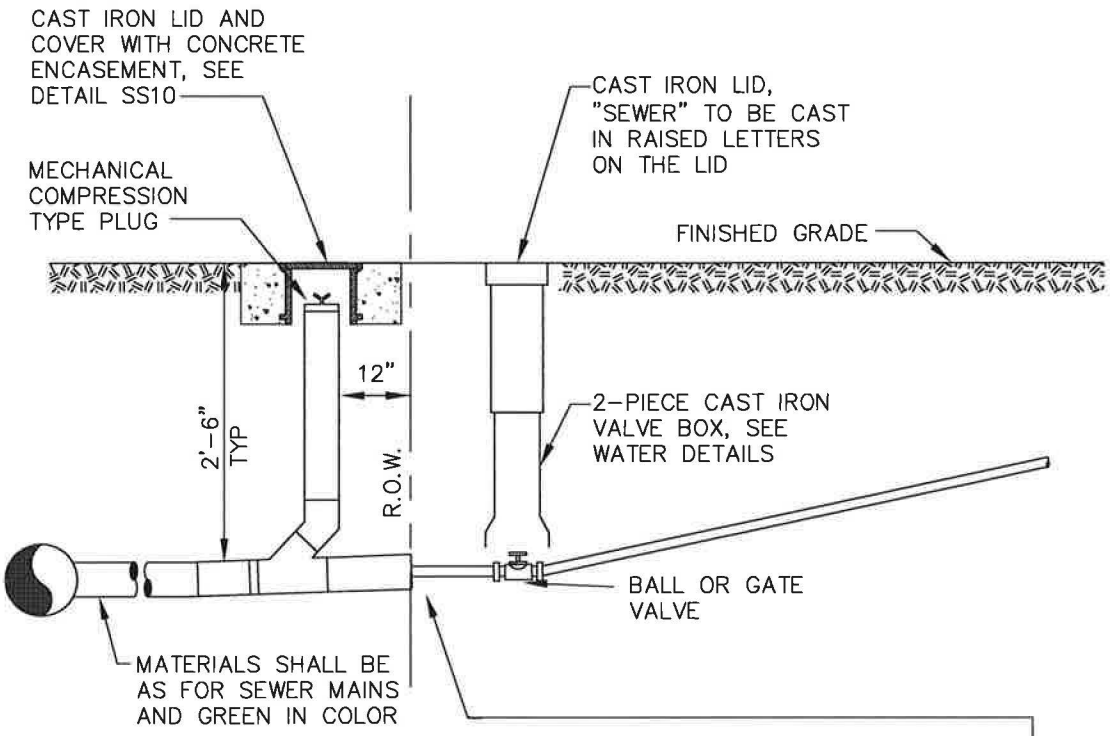

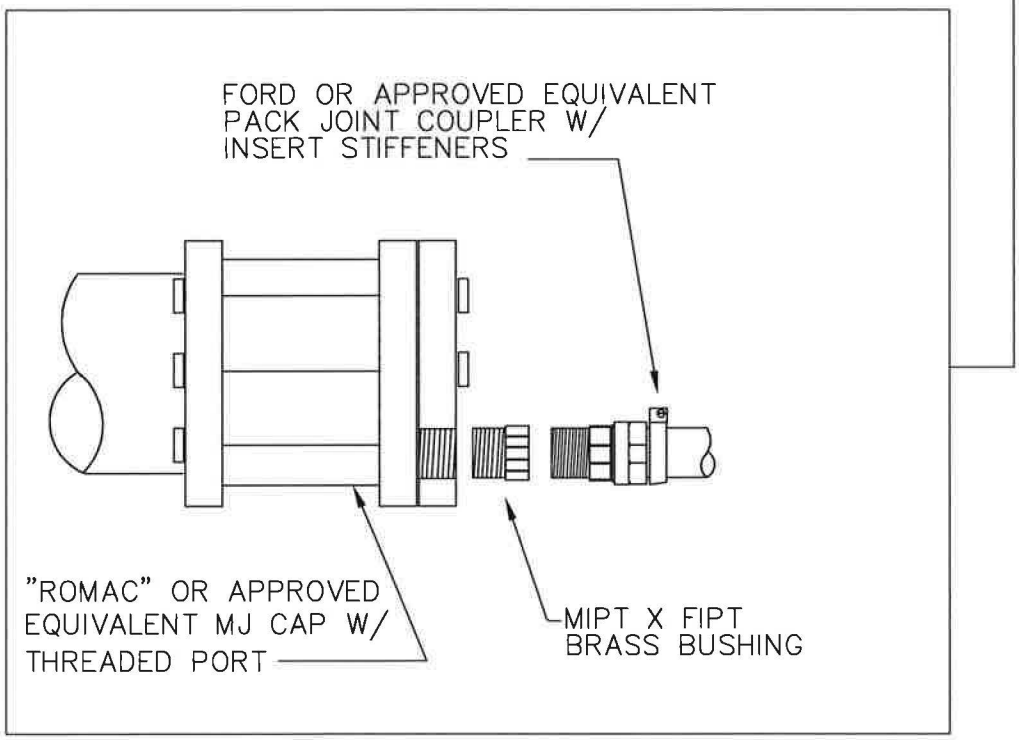

NOTE:

CHECK VALVE REQUIRED BETWEEN PUMP AND BALL VALVE

Approved: March 16, 2018 City Engineer Date **SANITARY SEWER STANDARD DETAIL**	City of BONNEY Lake	Dwg No: **SS13** **SMALL DIAMETER FORCE MAIN CONNECTION**