


#### NOTES:


1. PIPE CONNECTIONS TO MANHOLES SHALL BE WITH A WATER TIGHT FLEXIBLE RUBBER BOOT IN MANHOLE WALL, KOR-N-SEAL BOOT, "A" LOCK, OR EQUAL.
2. MANHOLES SHALL BE PRE-CHANNELED BY THE MANUFACTURER WITH A DROP OF GRADE THRU MANHOLE OF 0.10- FEET (SEE PAGE 2). FIBERGLASS CHANNELS ARE ACCEPTABLE.
3. LARGER MANHOLES WILL BE REQUIRED AT THE DISCRETION OF THE CITY ENGINEER BASED ON PIPE SIZE, NUMBER AND ORIENTATION OF PIPE(S).
4. MANHOLE COATINGS MAY BE REQUIRED IF DIRECTED BY THE CITY OR IF SPECIFIED IN SECTION 500.

PAGE 1 of 2


Approved:  March 16, 2018  
City Engineer Date  
SANITARY SEWER STANDARD DETAIL

City of  
**BONNEY**  
*Lake*


Dwg No: **SS1**  
**TYPICAL PRECAST  
MANHOLE**

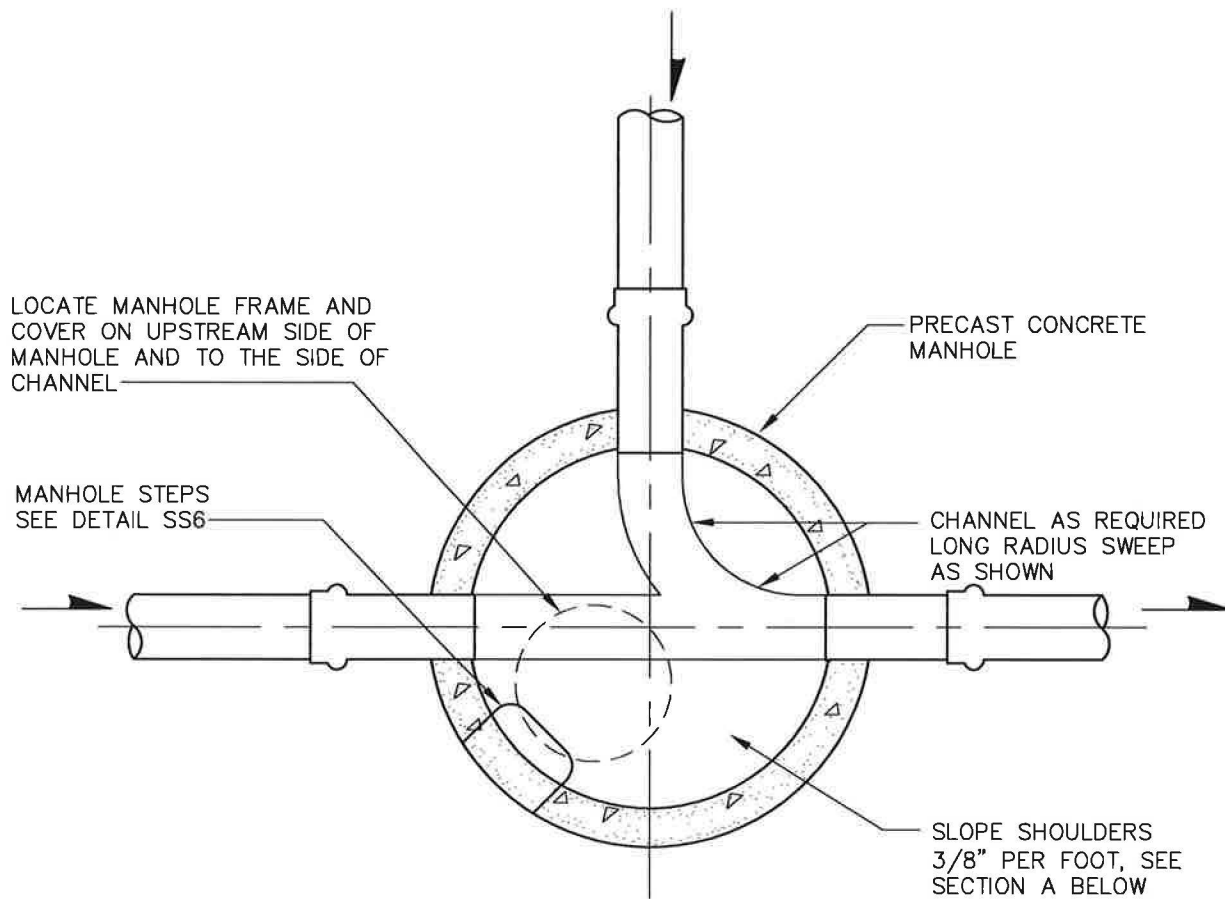

PLAN  
NO SCALE

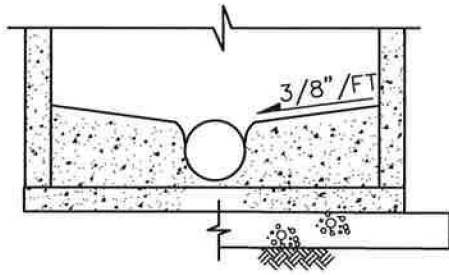

PRECAST CHANNEL  
SECTION A  
NO SCALE

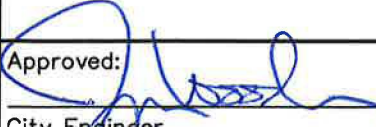Approved:  March 16, 2018  
 City Engineer Date  
**SANITARY SEWER STANDARD DETAIL**



Dwg No: **SS1**  
**TYPICAL PRECAST MANHOLE**