


NOTES:

- ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED.
- THE WATER METER SHALL BE LOCATED ADJACENT TO THE RIGHT-OF-WAY LINE AS DIRECTED BY THE CITY. THE WATER METER SHALL BE ACCESSIBLE BY THE CITY AT ALL TIMES.
- 3. METERS SHALL BE INSTALLED BY THE CITY OF BONNEY LAKE.
- WATER SERVICE LINE SHALL BE HIGH MOLECULAR POLYETHYLENE SDR7 (200 PSI).
- INDIVIDUAL PRESSURE REDUCING VALVE (WASHINGTON STATE DEPARTMENT OF HEALTH APPROVED) IS REQUIRED.
- STAINLESS STEEL STIFFENERS SHALL BE INCLUDED WITH ALL PACK JOINT COUPLINGS.

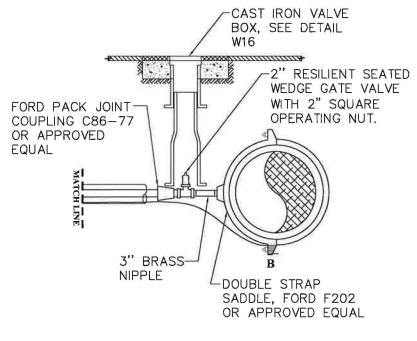

Approved City Engineer

March 16, 2018

Date

WATER STANDARD DETAIL

Dwg No:

W11

1-1/2" AND 2" WATER SERVICE