


**PRESSURE REDUCING VALVE
WILKINS 600 SERIES OR
APPROVED EQUAL (WITH
INTERNAL BYPASS AND STRAINER)**

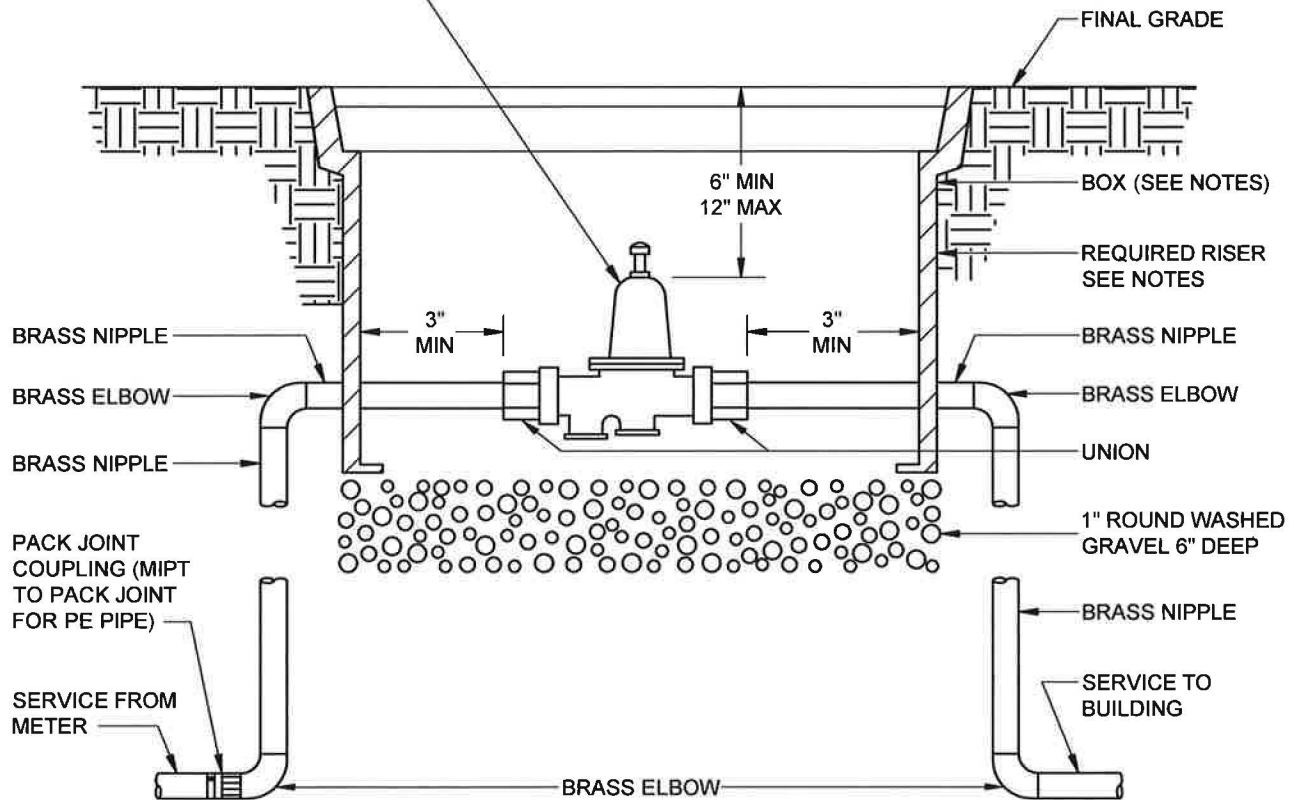

1. WHERE P.R.V. IS INSTALLED ON EXISTING SERVICE, CUT IN EXISTING SERVICE, INSTALL NEW BRASS FITTINGS REQUIRED TO MAKE A COMPLETE P.R.V. INSTALLATION.
2. BOX SHALL BE PER DETAIL W1.
3. REQUIRED RISER SHALL BE 6 INCH.
4. P.R.V. SIZE SHALL BE 1 INCH.

City Engineer

Date _____

City of
BONNEY
Lake

W23

INDIVIDUAL PRV