

Stairway Construction

Building Division

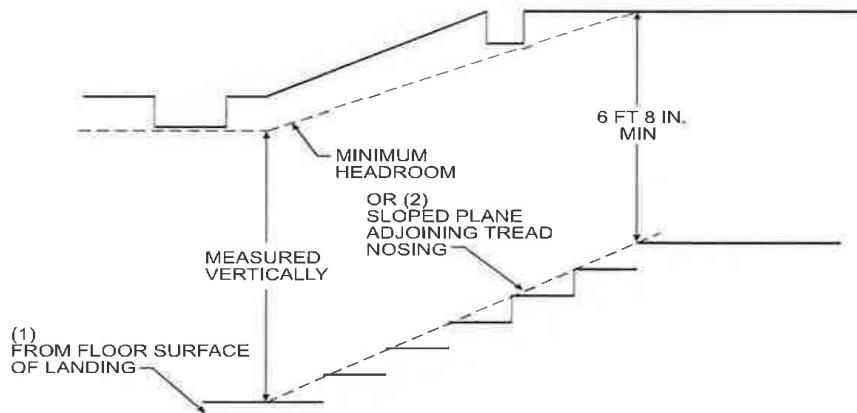


Figure R311.7.2(1)
MINIMUM HEADROOM

R311.7.1 Width. Stairways shall not be less than 36 inches (914 mm) in clear width at all points above the permitted handrail height and below the required headroom height.

R311.7.2 Headroom. The minimum headroom in all parts of the stairway shall not be less than 6 feet 8 inches (2032 mm) measured vertically from the sloped line adjoining the tread nosing or from the floor surface of the landing or platform on that portion of the stairway.


R311.7.3 Vertical rise. A flight of stairs shall not have a vertical rise larger than 12 feet (3658 mm) between floor levels or landings.

R311.7.5.1 Risers. The maximum riser height shall be $7\frac{3}{4}$ inches (196 mm). The riser shall be measured vertically between leading edges of the adjacent treads. The greatest riser height within any flight of stairs shall not exceed the smallest by more than $\frac{3}{8}$ inch (9.5 mm). Risers shall be vertical or sloped from the underside of the nosing of the tread above at an angle not more than 30 degrees (0.51 rad) from the vertical. Open risers are permitted provided that the opening between treads does not permit the passage of a 4-inch diameter (102 mm) sphere.


R311.7.5.2 Treads. The minimum tread depth shall be 10 inches (254 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the treads leading edge. The greatest tread depth within any flight of stairs shall not exceed the smallest by more than $\frac{3}{8}$ inch (9.5 mm).

2012 International Residential Code


Stairway Construction

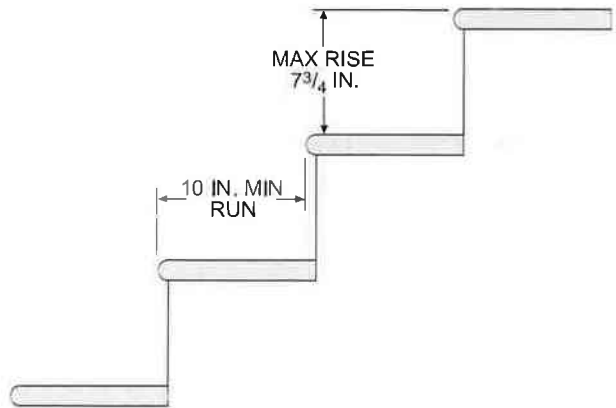

**Figure R311.7.5.1(1)
CONVENTIONAL STAIRWAY**

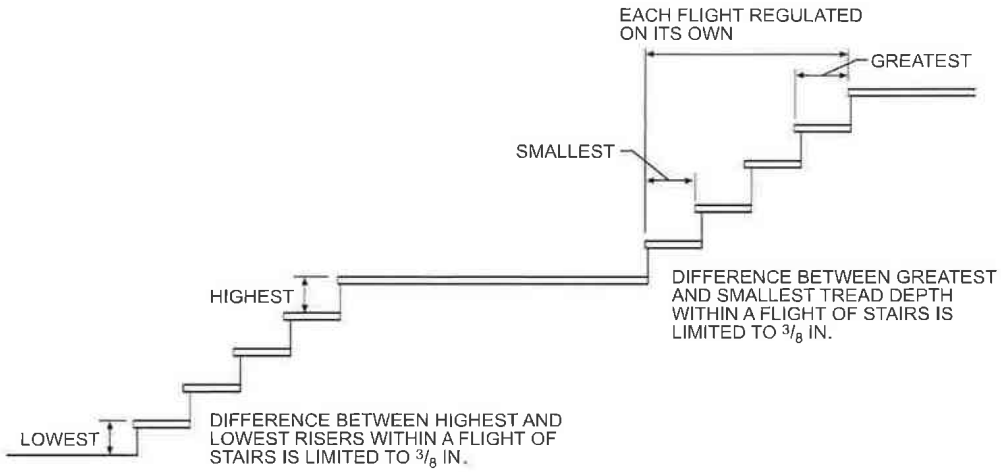

**Figure R311.7.5.1(2)
STAIR TOLERANCES**

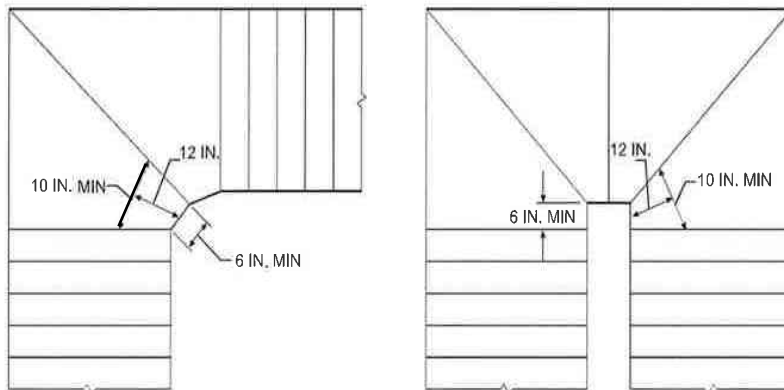

**Figure R311.7.5.2.1(1)
WINDERS**

2012 International Residential Code

Stairway Construction

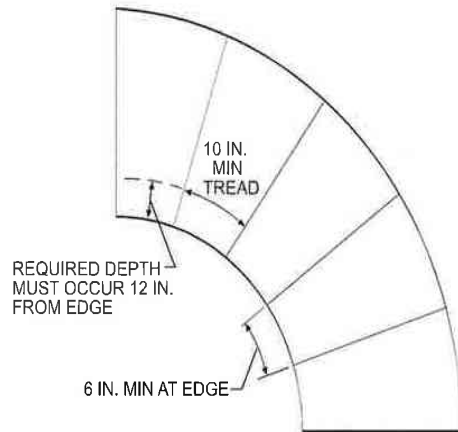


Figure R311.7.5.2.1(2)
WINDERS USED FOR CIRCULAR STAIRWAY

R311.7.5.2.1 Winder treads. Winder treads shall have a minimum tread depth of 10 inches (254 mm) measured between the vertical planes of the foremost projection of adjacent treads at the intersections with the walkline. Winder treads shall have a minimum tread depth of 6 inches (152 mm) at any point within the clear width of the stair. Within any flight of stairs, the largest winder tread depth at the walkline shall not exceed the smallest winder tread by more than 3/8 inch (9.5 mm). Consistently shaped winders at the walkline shall be allowed within the same flight of stairs as rectangular treads and do not have to be within 3/8 inch (9.5 mm) of the rectangular tread depth.

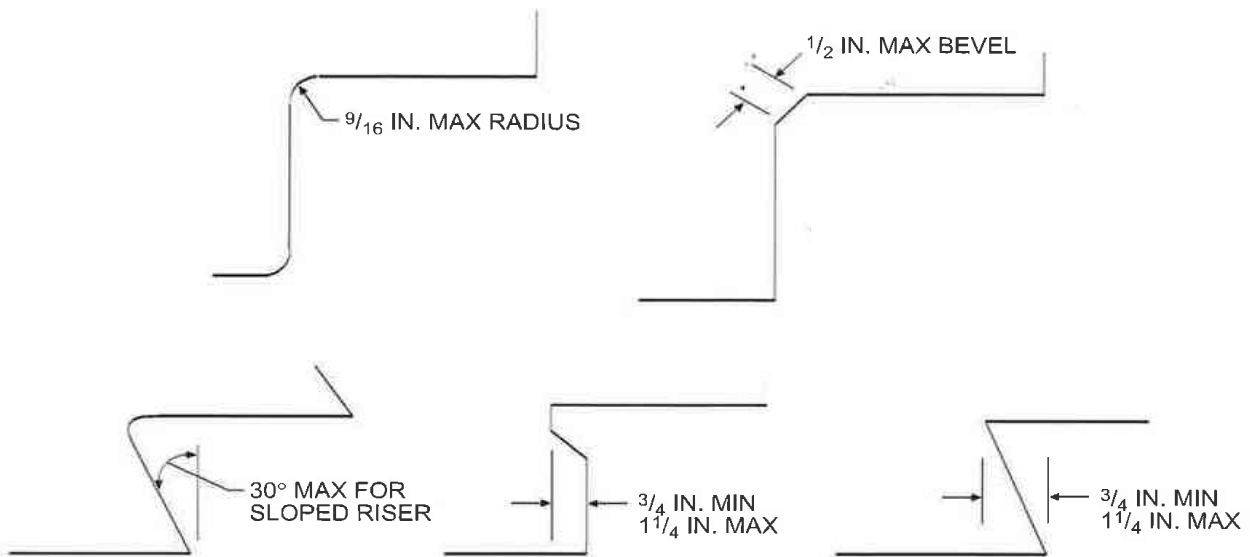


Figure R311.7.5.3
TREAD PROFILE

2012 International Residential Code